

Data sheet

# **Hot gas bypass regulator** Type KVC



KVC is a hot gas bypass regulator applied for the adaption of the compressor capacity to the actual evaporator load.

Placed in a bypass between high and low pressure sides of the refrigeration system, KVC imposes a lower limit on the compressor suction pressure by supplying the low pressure side with replacement capacity in the form of hot gas / cool gas from the high pressure side.

#### **Features**

- Accurate, adjustable pressure regulation
- Wide capacity and operating ranges
- · Pulsation damping design
- Stainless steel bellows

- · Compact angle design for easy installation
- "Hermetic" brazed construction
- Available with flare and ODF solder connections
- May be used in the following EX range: Category 3 (Zone 2)



#### Data sheet | Hot gas bypass regulator, type KVC

#### **Approvals**

UL LISTED, file SA7200

EAC

#### **Technical data**


Refrigerants	R22, R1270, R134a, R290, R404A, R407A, R407C, R407F, R448A, R449A, R450A, R452A, R507A, R513A, R600, R600a						
Regulating range	0.2 – 6.0 bar						
Regulating range	Factory setting = 2 bar						
Maximum working pressure	PS / MWP = 28 bar						
Maximum test pressure	Pe = 31 bar						
Medium temperature range	-45 – 130 °C						
Maximum P-band	2.0 bar						
	$KVC 12 = 0.68  \text{m}^3 /  \text{h}$						
K <sub>v</sub> value at maximum P-band ¹)	KVC 15 = 1.25 m <sup>3</sup> / h						
	$KVC 20 = 1.85 \text{ m}^3 / \text{ h}$						

<sup>&</sup>lt;sup>1</sup>) The K<sub>v</sub> value is the flow of water in [m<sup>3</sup>/h] at a pressure drop across valve of 1 bar,  $\rho = 1000 \text{ kg} / \text{m}^3$ 

This product is evaluated for R290, R600, R600a, R1270 by ignition source assessment in accordance with standard EN13463-1.

For complete list of approved refrigerants, visit www.products.danfoss.com and search for individual code numbers, where refrigerants are listed as part of technical data.

# Ordering



Туре		apacity ¹) W]			are ction <sup>2</sup> )	Code no.	Solder connection		Code no.	
	R22	R134a	R404A/ R507	R407C	[in.]	[mm]	Code no.	[in.]	[mm]	Code no.
KVC 12	7.6	4.8	6.9	8.4	1/2	12	034L0141	1/2	-	034L0143
KVC 12	7.6	4.8	6.9	8.4	-	-	-	-	12	034L0146
KVC 15	14.9	9.4	13.6	16.4	5/8	16	034L0142	5/8	16	034L0147
KVC 22	19.1	12.0	17.4	21.0	-	-	-	7/8	22	034L0144

- 1) Rated capacity is the regulator capacity at:
  - evaporating temperature  $t_e = -10$  °C,
  - condensing temperature  $t_c = 25$  °C,
  - offset = 0.7 ba
- <sup>2</sup>) KVC is supplied without flare nut. Separate flare nuts can be ordered:
  - 1/2 in. / 12 mm, code no. 011L1103,
- 5/8 in. / 16 mm, code no. 011L1167.

The connection dimensions chosen must not be too small, since gas velocities in excess of 40 m/s at the inlet of the regulator can give flow noise.

If the discharge tube temperature becomes too high in relation to the compressor specification, the installation of an injection valve in a bypass between liquid line and compressor suction line is recommended.

# **REACH requirements**

All Danfoss products fulfill the requirements in REACH.

One of the obligations in REACH is to inform customers about presence of Candidate list substances if any, we hereby inform you about one substance on the candidate list: an O-ring used in this product contains Diisopentyl phthalate (CAS no: 605-50-5) in a concentration above 0.1% w/w.



# **Replacement capacity**

**R22** 

Tumo	Offset ∆p	Q 1) [k	w] suction ga	as temperatur	e t, after pres	sure / tempera	ature reductio	n [°C]
Туре	[bar]	-45	-40	-30	-20	-10	0	10
	0.10	-	2.3	2.4	2.5	2.5	2.6	2.6
	0.15	-	3.5	3.6	3.7	3.8	3.9	4.0
	0.20	-	4.5	4.7	4.8	4.9	5.0	5.1
KVC 12	0.30	-	5.9	6.1	6.3	6.4	6.5	6.7
KVC 12	0.50	-	6.6	6.8	7.1	7.2	7.3	7.5
	0.70	-	7.0	7.2	7.4	7.6	7.8	7.9
	1.00	-	7.6	7.9	8.1	8.3	8.5	8.6
	1.20	-	8.2	8.5	8.7	8.9	9.1	9.3
	0.10	-	3.5	3.6	3.7	3.8	3.9	4.0
	0.15	-	4.5	4.7	4.8	4.9	5.0	5.1
	0.20	-	5.9	6.1	6.3	6.4	6.5	6.7
KVC 15	0.30	-	8.2	8.5	8.7	8.9	9.1	9.3
KVC 13	0.50	-	11.7	12.1	12.4	12.7	13.0	13.2
	0.70	-	13.7	14.2	14.6	14.9	15.2	15.5
	1.00	-	15.6	16.2	16.7	17.0	17.3	17.7
	1.20	-	16.8	17.4	17.9	18.3	18.7	19.0
	0.10	-	3.7	3.8	3.9	4.0	4.1	4.2
	0.15	-	5.1	5.2	5.4	5.5	5.6	5.7
	0.20	-	6.8	7.0	7.3	7.4	7.5	7.7
KVC 22	0.30	-	8.4	8.6	8.9	9.1	9.3	9.5
RVC ZZ	0.50	-	14.1	14.5	15.0	15.3	15.6	15.9
	0.70	-	17.6	18.1	18.7	19.1	19.5	19.9
	1.00	-	21.4	22.4	23.1	23.6	24.1	24.5
	1.20	-	23.8	24.6	25.4	25.9	26.4	26.9

# **Correction factors**

When selecting, the required regulator capacity is to be multiplied by a correction factor dependent on the condensing temperature.

 $\label{eq:System} \mbox{System capacity} \times \mbox{correction factor} = \mbox{table capacity}$ 

<sup>1)</sup> The capacities are based on: - condensing temperature t<sub>1</sub> = 25 °C.



# **Replacement capacity** (continued)

# R134a

T	Offset ∆p	Q 1) [k	W] suction ga	s temperatur	e t, after pres	sure / tempera	ature reductio	n [°C]
Type	[bar]	-45	-40	-30	-20	-10	0	10
KVC 12	0.10	-	-	1.4	1.4	1.5	1.7	1.7
	0.15	-	-	2.1	2.3	2.4	2.5	2.6
	0.20	-	-	2.9	3.0	3.1	3.2	3.4
	0.30	-	-	3.7	3.9	4.1	4.3	4.5
KVC 12	0.50	-	-	4.2	4.3	4.5	4.8	4.9
	0.70	-	-	4.4	4.5	4.8	5.0	5.2
	1.00	-	-	4.8	5.0	5.2	5.5	5.8
	1.20	-	-	5.1	5.4	5.6	5.8	6.1
	0.10	-	-	2.1	2.3	2.4	2.5	2.6
	0.15	-	-	2.9	3.0	3.1	3.2	3.4
	0.20	_	_	3.7	3.9	4.1	4.3	4.5
KVC 15	0.30	-	-	5.1	5.4	5.6	5.8	6.1
KVC 13	0.50	-	-	7.4	7.7	8.0	8.4	8.7
	0.70	-	-	8.7	9.1	9.4	9.9	10.2
	1.00	-	-	9.9	10.2	10.7	11.3	11.7
	1.20	-	-	10.6	11.1	11.6	12.2	12.6
	0.10	-	-	2.3	2.4	2.5	2.6	2.8
	0.15	-	-	3.2	3.3	3.5	3.6	3.7
	0.20	-	-	4.3	4.4	4.6	4.9	5.1
KVC 22	0.30	-	-	5.2	5.5	5.7	6.0	6.3
KVC ZZ	0.50	-	-	8.9	9.3	9.7	10.1	10.5
	0.70	-	-	11.0	11.6	12.0	12.6	13.1
	1.00	-	-	13.7	14.3	14.9	15.6	16.3
	1.20	-	-	15.0	15.7	16.3	17.2	17.8

# **Correction factors**

When selecting, the required regulator capacity is to be multiplied by a correction factor dependent on the condensing temperature.

 $\label{eq:System} \mbox{System capacity} \times \mbox{correction factor} = \mbox{table capacity}$ 

<sup>1)</sup> The capacities are based on: - condensing temperature t<sub>1</sub> = 25 °C.



# **Replacement capacity** (continued)

# R404A/R507

Туре	Offset Δp	Q 1) [k	(W] suction ga	s temperatur	e t, after pres	sure / temper	ature reductio	on [°C]
	[bar]	-45	-40	-30	-20	-10	0	10
	0.10	-	1.9	2.0	2.1	2.2	2.3	2.4
	0.15	-	3.0	3.1	3.3	3.4	3.5	3.6
	0.20	-	3.9	4.1	4.2	4.5	4.7	4.7
KVC 12	0.30	-	5.1	5.4	5.6	5.8	6.0	6.1
KVC 12	0.50	-	5.7	6.0	6.4	6.6	6.8	7.0
	0.70	-	6.0	6.4	6.6	6.9	7.2	7.3
	1.00	-	6.6	6.9	7.2	7.5	7.8	8.0
	1.20	-	7.0	7.4	7.7	8.0	8.4	8.5
	0.10	-	3.0	3.1	3.3	3.4	3.5	3.6
	0.15	-	3.9	4.1	4.2	4.5	4.7	4.7
	0.20	-	5.1	5.4	5.6	5.8	6.0	6.1
KVC 15	0.30	-	7.0	7.4	7.7	8.0	8.4	8.5
KVC 15	0.50	-	10.1	10.6	11.1	11.6	12.0	12.3
	0.70	-	11.8	12.5	13.0	13.6	14.1	14.4
	1.00	-	13.5	14.2	14.8	15.5	16.1	16.4
	1.20	-	14.5	15.3	16.0	16.6	17.3	17.7
	0.10	-	3.2	3.3	3.5	3.6	3.7	3.8
	0.15	-	4.3	4.6	4.8	5.0	5.2	5.3
	0.20	-	5.8	6.1	6.4	6.7	7.0	7.1
KVC 22	0.30	-	8.2	8.6	8.9	9.3	9.8	9.9
NVC ZZ	0.50	-	12.1	12.8	13.4	13.9	14.4	14.7
	0.70	-	15.2	16.0	16.6	17.4	18.1	18.4
	1.00	-	18.8	19.8	20.7	21.5	22.4	22.8
	1.20	-	20.5	21.6	22.6	23.5	24.5	25.0

# **Correction factors**

When selecting, the required regulator capacity is to be multiplied by a correction factor dependent on the condensing temperature.

 $\label{eq:System} \mbox{System capacity} \times \mbox{correction factor} = \mbox{table capacity}$ 

<sup>1)</sup> The capacities are based on: - condensing temperature t<sub>1</sub> = 25 °C.



# **Replacement capacity** (continued)

# R407C

Туре	Offset ∆p	Q 1) [k	w] suction ga	s temperatur	e t, after pres	sure / tempera	ature reductio	on [°C]
	[bar]	-45	-40	-30	-20	-10	0	10
	0.10	-	2.4	2.6	2.7	2.8	2.9	3.0
	0.15	-	3.7	3.9	4.0	4.2	4.3	4.6
KVC 12	0.20	-	4.8	5.0	5.2	5.4	5.6	5.8
	0.30	-	6.3	6.5	6.9	7.0	7.2	7.6
KVC 12	0.50	-	7.0	7.3	7.7	7.9	8.1	8.6
	0.70	-	7.4	7.7	8.1	8.4	8.7	9.0
	1.00	-	8.1	8.5	8.8	9.1	9.4	9.8
	1.20	-	8.7	9.1	9.5	9.8	10.1	10.6
	0.10	-	3.7	3.9	4.0	4.2	4.3	4.6
	0.15	-	4.8	5.0	5.2	5.4	5.6	5.8
	0.20	_	6.3	6.5	6.9	7.0	7.2	7.6
KVC 15	0.30	-	8.7	9.1	9.5	9.8	10.1	10.6
KVC 13	0.50	-	12.4	12.9	13.5	14.0	14.4	15.0
	0.70	-	14.5	15.2	15.9	16.4	16.9	17.7
	1.00	-	16.5	17.3	18.2	18.7	19.2	20.2
	1.20	-	17.8	18.6	19.5	20.1	20.8	21.7
	0.10	-	3.9	4.1	4.3	4.4	4.6	4.8
	0.15	-	5.4	5.6	5.9	6.1	6.2	6.5
	0.20	-	7.2	7.5	8.0	8.1	8.3	8.8
KVC 22	0.30	-	8.9	9.2	9.7	10.0	10.3	10.8
RVC 22	0.50	-	14.9	15.5	16.4	16.8	17.3	18.1
	0.70	-	18.7	19.4	20.4	21.0	21.6	22.7
	1.00	_	22.7	24.0	25.2	26.0	26.8	27.9
	1.20	-	25.2	26.3	27.7	28.5	29.3	30.7

# **Correction factors**

When selecting, the required regulator capacity is to be multiplied by a correction factor dependent on the condensing temperature.

 $\label{eq:System} \mbox{System capacity} \times \mbox{correction factor} = \mbox{table capacity}$ 

<sup>1)</sup> The capacities are based on: - condensing temperature t<sub>1</sub> = 25 °C.



#### Sizing

For optimum performance, it is important to select a KVC valve according to system conditions and application.

The following data must be used when sizing a KVC valve:

- Refrigerant
- Minimum suction temperature:  $t_s$  in [°C] / [bar]
- Compressor load in [kW]
- Evaporator load in [kW]
- Condensing temperature: t₁ in [°C]
- · Connection type: flare or solder
- · Connection size in [in.]

#### Valve selection

#### Example

When selecting the appropriate valve it may be necessary to convert the actual evaporator capacity using a correction factor.

This is required when your system conditions are different than the table conditions. The selection is also dependant on the acceptable pressure drop across the valve.

The following example illustrates how this is done:

- · Refrigerant: R134a
- Minimum suction temperature:  $t_s = -12 \,^{\circ}\text{C} \sim 0.9 \, \text{bar}$
- Compressor capacity at -12 °C = 15.4 kW
- Evaporator load at -12 °C = 10.0 kW
- Condensing temperature: t<sub>i</sub> = 35 °C
- Connection type: solder
- Connection size: 5/8 in.

## Step 1

Determine the correction factor for condensing temperature  $t_{\rm l}.$ 

From the correction factors table (see below) a condensing temperature of 35 °C, R134a corresponds to a factor of 1.10.

# Correction factors for condensing temperature t<sub>I</sub>

t <sub>1</sub> [°C]	10	15	20	25	30	35	40	45	50
R134a	0.88	0.92	0.96	1.0	1.05	1.10	1.16	1.23	1.31
R22	0.90	0.93	0.96	1.0	1.05	1.10	1.13	1.18	1.24
R404A/R507	0.84	0.89	0.94	1.0	1.07	1.16	1.26	1.40	1.57
R407C	0.88	0.91	0.95	1.0	1.05	1.11	1.18	1.26	1.35

#### Step 2

The required replacement capacity is defined as the (compressor capacity – the evaporator load) divided by the correction factor = (15.4-10.0) / 1.10 = 4.9 kW

#### Step 3

Now select the appropriate capacity table and choose the column for minimum suction temperature  $t_s = -20\,^{\circ}\text{C}$ .

Using the corrected replacement capacity, select a valve that provides an equivalent or greater capacity than required.

KVC 15 delivers 5.4 kW at an offset of 0.3 bar. Based on the required connection size of  $^{5}/_{8}$  in. ODF, the KVC 15 is the proper selection for this example.

#### Step 4

KVC 15, 5/8 in. solder connection: **code no. 034L0147**, see ordering list.



#### **Design / Function**

# 2 3 4 5 6 9

KVC

KVC regulates only in dependence on the outlet pressure. Pressure variations on the inlet side of the regulator do not affect the degree of opening since KVC is equipped with an equalization bellows (6). This bellows has an effective area corresponding to that of the valve seat.

The hot gas bypass regulator KVC opens at a fall in pressure on the outlet side, i.e. when the

pressure in the evaporator is beyond the set


value.

The hot gas bypass regulator is also equipped with an effective damping device (9) against pulsations which can normally arise in a refrigeration plant.

The damping device helps to ensure long life for the regulator without impairing regulation accuracy.

- 1. Protective cap
- 2. Gasket
- 3. Setting screw
- 4. Main spring
- 5. Valve body
- 6. Equalization bellows
- 7. Valve plate
- 8. Valve seat
- 9. Damping device

#### P-band and Offset

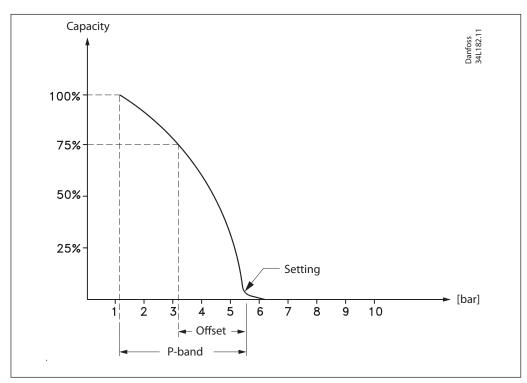

## **Proportional band**

The proportional band or P-band is defined as the amount of pressure required to move the valve plate from closed to full open position.

#### Example:

If the valve is set to open at 4 bar and the valve p-band is 2, the valve will give maximum capacity when the discharge pressure reaches 2 bar.

#### Offset

The offset is defined as the permissible pressure variation in suction line pressure (temperature). It is calculated as the difference between the required working pressure and the minimum allowable pressure.


The offset is always a part of the P-band.

# Example with R404A:

A suction temperature ahead of the compressor of 5 °C  $\sim$  6 bar is required, and the temperature must not drop below 0 °C  $\sim$  5 bar. The offset will then be 1 bar.



# **Dimensions and weights**

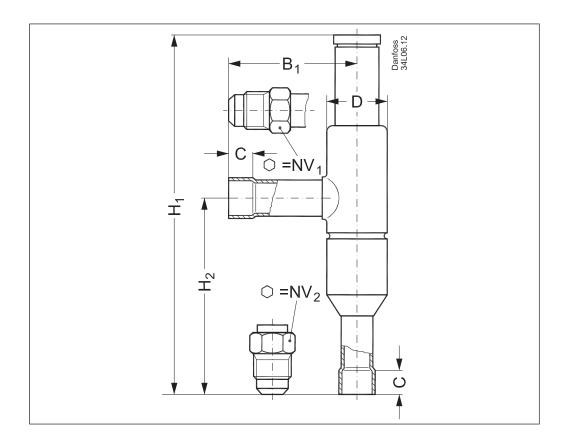

	Connection				NV <sub>1</sub>	NV <sub>2</sub>	H <sub>1</sub>	H <sub>2</sub>	B <sub>1</sub>	С	øD	Net
Туре	Flare		Solder ODF		INV <sub>1</sub>	INV <sub>2</sub>	П	П2	D <sub>1</sub>	solder	ØD	weight
	[in.]	[mm]	[in.]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[Kg]
KVC 12	1/2	12	1/2	12	19	24	179	99	64	10	30	0.4
KVC 15	5/8	16	5/8	16	24	24	179	99	64	12	30	0.4
KVC 22	-	-	5/8	22	-	-	179	99	64	17	30	0.4

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed.

All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.